


Byerly Seismographic Vault, Berkeley, C BDSN Sta BKS
 Rcrd of Mon Jun 28, 2021 18:29:22.2 PDT (GPS)
 Frequency Band Processed: 3.3 secs to 40.0 Hz
 CISN/CSMIP Preliminary Strong Motion Processing - Subject to Revision

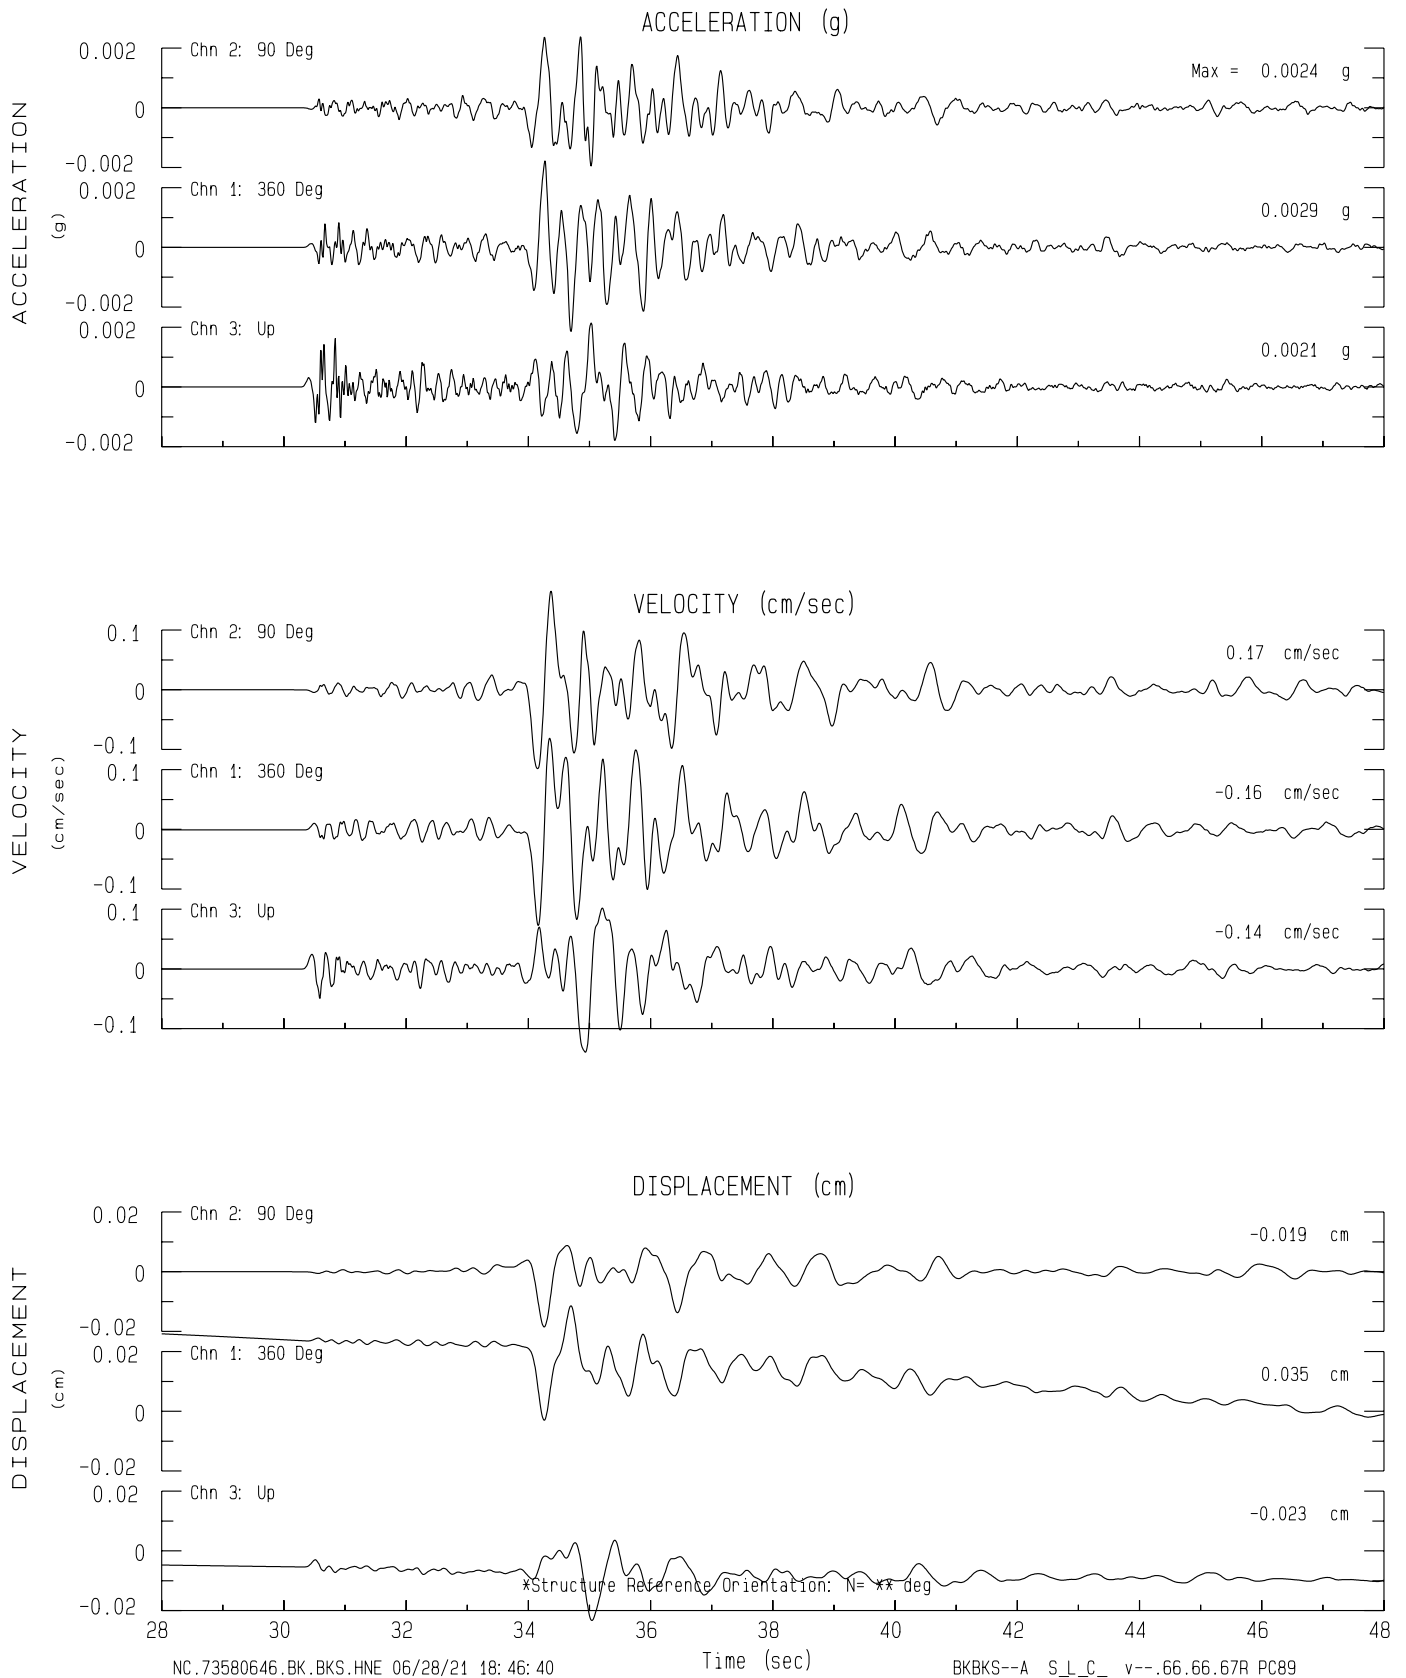

Byerly Seismographic Vault, Berkeley, C Sta NC.73

Rcd of Mon Jun 28, 2021 18:29:22.2 PDT

Frequency Band Processed: 3.3 secs to 40.0 Hz

Automated Strong Motion Processing - Preliminary and Subject to Revision

